

# TEST REPORT

No. 5432/2/92

for

Unglazed ceramic vitreous tile TOP CER Mosaic  
Marking 4408 RC Naps, coloured pink-grey spotted

out of the produktionprogram of the firm

TOP CER  
Industria de Ceramica L.da  
P-3770 OLIVEIRA DO BAIRRO

Subject of test:

Testing of ceramic floor coverings, determination of the anti-slip properties; wet loaded barefoot areas; walking method - ramp test

Standard of determination:

DIN 51 097, ed. 11/92

Requirements of the board of control "Slide-blocking Floorings -  
Liste NB"

Applicant:

TOP CER  
Industria de Ceramica L.da  
Z.I. Oià  
P-3770 OLIVEIRA DO BAIRRO

Order from: 11.12.1992  
Arrival of samples: 14.12.1992  
Sampling date: 12.12.1992  
Sampling place: Hamburg  
Sampler: R. Mazzearella

The report has 2 pages.

Publication and reproduction of this report is only allowed in unabridged form. The report is given for 4 years (beginning data of delivery report).

Description of test material

Trade name: Unglazed ceramic vitreous tile  
TOP CER Mosaic  
Marking 4408 RC Naps  
coloured pink-grey spotted

Manufacturer: TOP CER  
Industria de Ceramica L.da  
Oliveira do Bairro/Portugal

Material: vitreous

Quality: first sort

Dimensions (length, width, thickness): 96 x 96 x 9 mm

Surface: unglazed, profiled  
(round naps  $\phi$  14 mm)

Marks on the back side: TOP CER Made in Portugal

Testing object

Dimension (length, width): 1,0 x 0,5 m  
Joint (width): 3 mm (given by the fixing unit)  
Quality joints: Cement mortar  
Arrangement of the profil:  
~~with-direction~~/ without direction

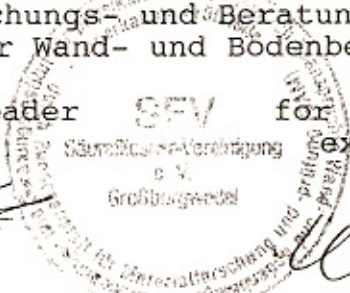
Result



Average inclination angle: 26°

Application - in accordance  
to class of slide-blocking: A + B + C

Remarks: none

Säurefließner-Vereinigung e. V.  
Untersuchungs- und Beratungsinstitut  
für Wand- und Bodenbeläge

Institute leader  for the accuracy  
examination

  
(Dr.-Ing. E. H. Nolting)   
(Dipl.-Ing. H. Kaufhold)